

Laboratorium Techniki Budowlanej
Sp. z o.o.
Dąbrowa Górnicza 41-306, ul. Laski 83
NIP 6292465943; KRS 0000447876
Jednostka notyfikowana/Notified body 1827
www.LTB.org.pl



tel/fax: (+48) 32 26 4 079 kom: 602 15 28 97; 608 50 66 35; 604 97 62 07
Bank Śląski S.A. o/Dąbrowa Górnicza nr 17 1050 1360 1000 0023 6773 9022

AB 661

Evidence of Type Testing (TT)
according to Standard EN 14351-1+A2
№ 535/B – 2017 – 3


Laboratorium Techniki Budowlanej used the calculation method, in accordance with Standard EN ISO 10077-1:2006 and EN ISO 10077-2:2012, to define the thermal insulation of windows

IDEAL 7000

system described in test report 535/B-2017, manufactured by:

„SŁOWIŃSCY” Sp. J.
62-400 Słupca, ul. Wspólna 2, Poland

Test's results		
Cross section	U_f [W/m ² K]	Ψ [W/mK]
Frame / Leaf	1,2	0,038
IGU	0,5	
U_w [W/m ² K] for window 1,23 x 1,48 m	0,82	
The results of the examination refer only to the tested sample and the test conditions. The parameters for other constructions should be declared in compliance with the provisions specified in standard EN 14351-1+A2.		

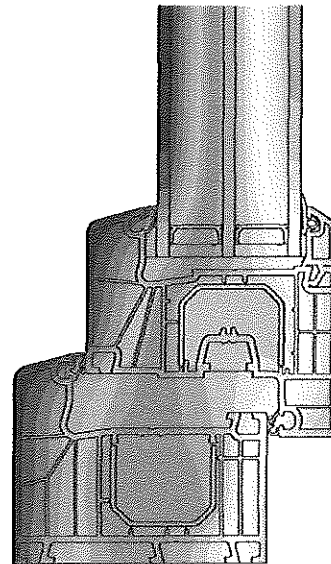

Quality Manager


M. Żyła
Maciej Żyła



Engineering Manager

Bogdan Wójtowicz
mgr inż. Bogdan Wójtowicz

Dąbrowa Górnicza, dated 09th May 2017



Laboratorium Techniki Budowlanej
Sp. z o.o.
Dąbrowa Górnicza 41-306, ul. Laski 83
NIP 6292465943; KRS 0000447876
Jednostka notyfikowana/Notified body 1827
www.LTB.org.pl



AB 661

tel/fax: (+48) 32 26 4 079 kom: 602 15 28 97; 608 50 66 35; 604 97 62 07
Bank Śląski S.A. o/Dąbrowa Górnicza nr 17 1050 1360 1000 0023 6773 9022

Evidence of Type Testing (TT)
according to Standard EN 14351-1+A2
№ 535/B – 2017 – 4

Laboratorium Techniki Budowlanej used the calculation method, in accordance with Standard EN ISO 10077-1:2006 and EN ISO 10077-2:2012, to define the thermal insulation of doors


IDEAL 7000

system described in test report 535/B-2017, manufactured by:

„SŁOWIŃSCY” Sp. J.


62-400 Słupca, ul. Wspólna 2, Poland

Test's results		
Cross section	U_f [W/m ² K]	Ψ [W/mK]
Frame / Leaf	1,3	0,039
Leaf / Mullion	1,3	0,039
Leaf / Threshold	1,8	0,038
IGU	0,5	
U_w [W/m ² K] for doors 1,23 x 2,18 m	1,0	
The results of the examination refer only to the tested sample and the test conditions. The parameters for other constructions should be declared in compliance with the provisions specified in standard EN 14351-1+A2.		

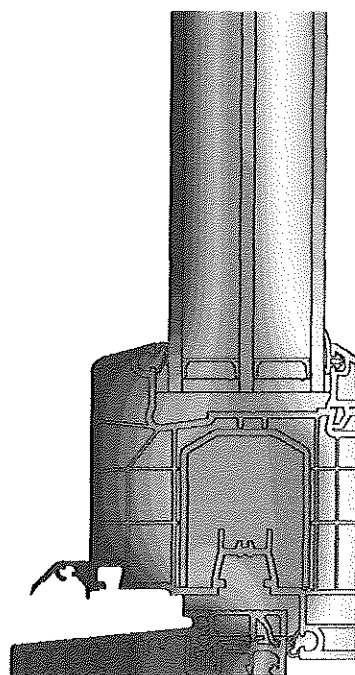

Quality Manager

M. Żyła
Małgorzata Żyła

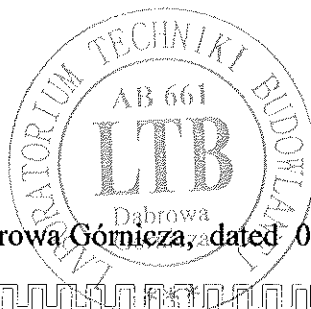

Engineering Manager

Bogdan Wójtowicz
mgr inż. Bogdan Wójtowicz

Dąbrowa Górnicza, dated 09th May 2017