

Laboratorium Techniki Budowlanej  
 Sp. z o.o.  
 Dąbrowa Górnicza 41-306, ul. Laski 83  
 NIP 6292465943; KRS 0000447876  
 Jednostka notyfikowana/Notified body 1827  
 www.LTB.org.pl



AB 661


tel/ fax (0-...)(32) 26 44 079; tel. (0-608) 50 66 32, (0-608) 50 66 35  
 Bank Śląski o/Dąbrowa Górnicza nr 57 1050 1272 1000 0022 3368 1416

**Initial Type Testing Certificate**  
**pertinent to Standard EN 14351-1+A1**  
**№ 258/B – 2016 – 2**

Laboratorium Techniki Budowlanej used the calculation method, in accordance with Standard EN ISO 10077-1:2006 and EN ISO 10077-2:2012, to define the thermal insulation of the windows *THERMAX 2 ULTRA* system described in test report 258/B-2016, manufactured by:

**„SŁOWIŃSCY” sp. j.**  
 ul. Wspólna 2  
 62-400 Słupca, Poland

Test's results		
Cross section	Frame/sash	Sill/sash
$U_f$ [W/m <sup>2</sup> K]	0,86	0,86
$\Psi$ [W/mK]	0,052	0,052
$U_g$ [W/m <sup>2</sup> K]	0,5	
$U_w$ [W/m <sup>2</sup> K] for window 1,23x1,48 m	<b>0,75</b>	
The results of the examination refer only to the tested sample and the test conditions. The parameters for other objects should be declared in compliance with the provisions specified in standard EN 14351-1+A1		

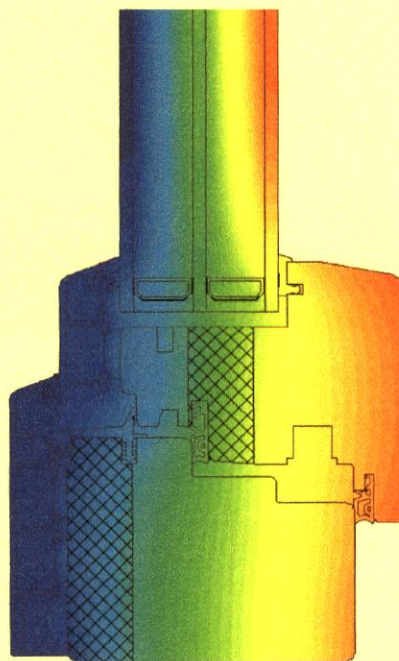

Quality Manager

*M. Żyła*  
 Maciej Żyła

Engineering Manager

*Bogdan Wójtowicz*  
 mgr inż. Bogdan Wójtowicz



Dąbrowa Górnicza, dated 19<sup>th</sup> August, 2016